


Typical External Installation Survey Sheet

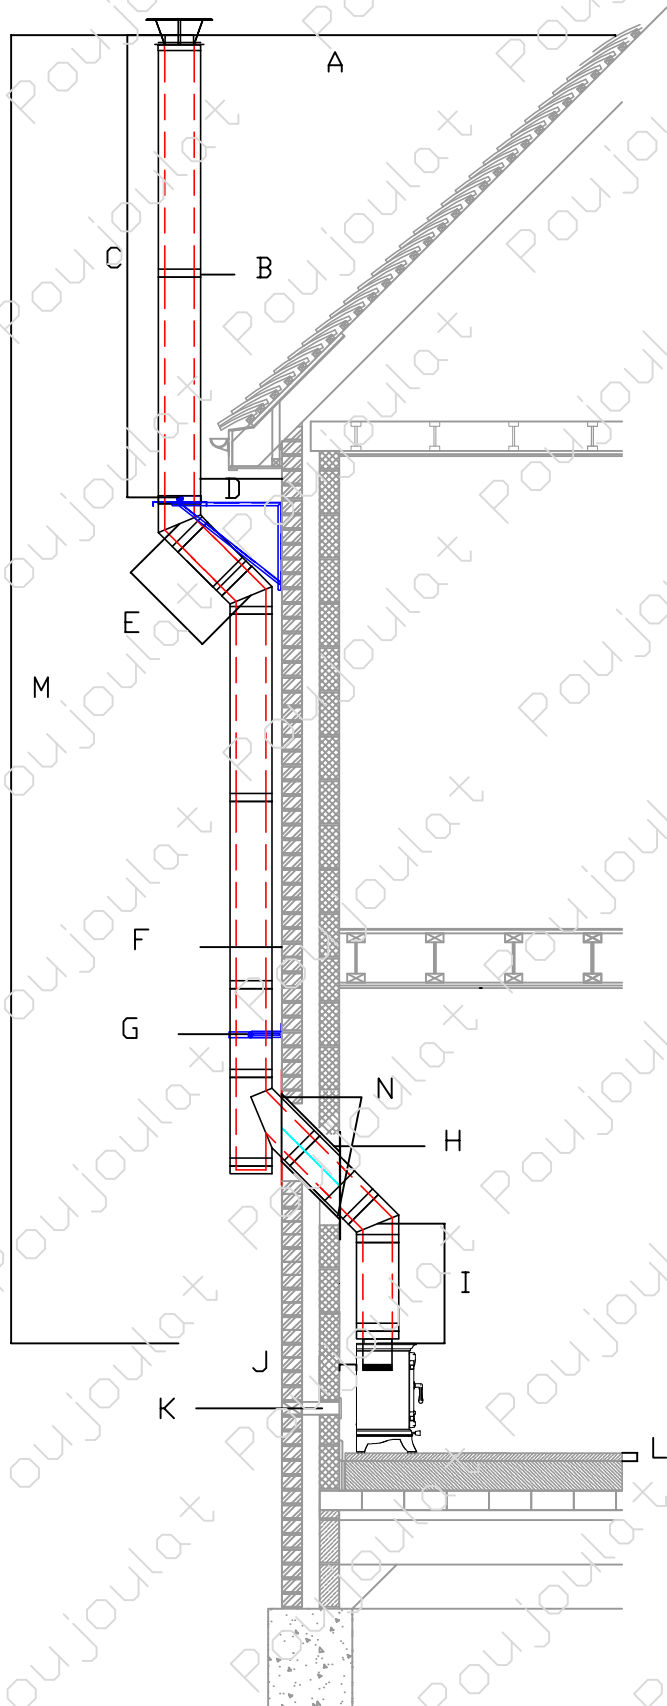

The following are a list of building regulations, Poujoulat specific installation instructions, and HETAS guidelines.

A - Minimum distance from outer casing of flue to nearest part of roof on a horizontal line as shown is 2300mm.

B - If flue is higher than 2 meters from the last support, re-inforced locking bands must be used at each joint above last support.

C - Flue must not be higher than 3 meters above the last support.

D - Maximum distance for 130 and 150 diameter flue is 400mm.
- Maximum distance for 180 and 200 diameter flue is 600mm.

E - Maximum total offset length should not exceed 20% of total pipe connection and chimney length.

F - Minimum distance from wall to outer case of flue is 50mm.

G - Wall brackets to be installed every 4 meters.

H - Wall sleeve is required to protect flue through wall cavity.

I - Minimum suggested vertical length from appliance outlet before a bend is 600mm.

J - Appliance manufacturer minimum distance to combustibles.

K - Possible air vent required.

L - Check appliance manufacturer and building regulations for minimum hearth requirements.

M - Minimum height from appliance outlet to terminal is 4500mm.

N - Fire rope to be used between chimney and wall sleeve to allow thermal movement.

□ - No more than 2 offsets from appliance to terminal, with bends of no more than 45°. (90° tee at appliance counts as 1 offset).